

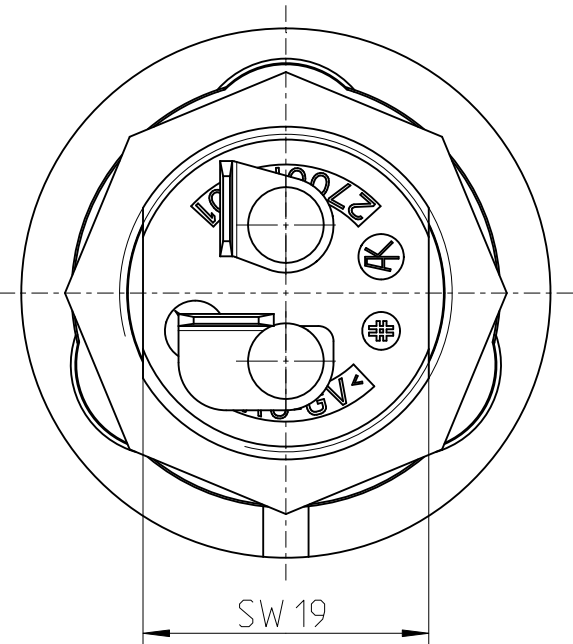
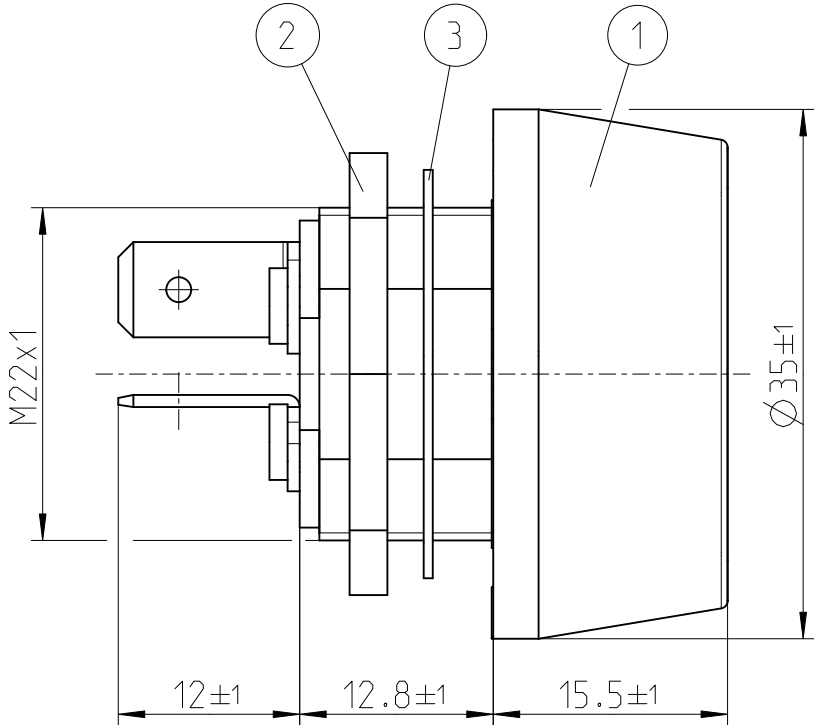


Schutzvermerk DIN ISO 16016 beachten / REFER TO PROTECTION NOTICE DIN ISO 16016

AK-Nr. AK-NO.	HERTH+BUSS-Nr. HERTH+BUSS-NO.	Pos. POS.	AK-Nr. AK-NO.	Benennung DESCRIPTION	Menge QTY.	Einh. UNIT
270011001	70468106	1	270110100	ZB-Druckknopfschalter PUSH-BUTTON ASSY.	1	Stck PCS
		2	010600300	Achtkantmutter M22x1 NUT	1	Stck PCS
		3	011520300	Unterlegscheibe M22 WASHER	1	Stck PCS

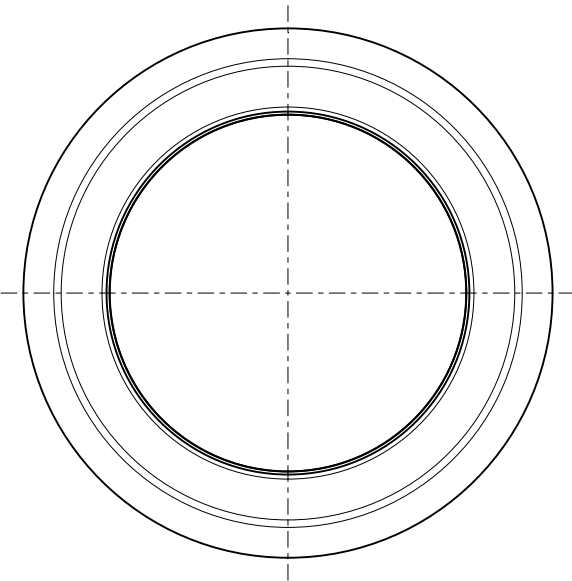


Flachstecker 6.3 x 0.8
TAB

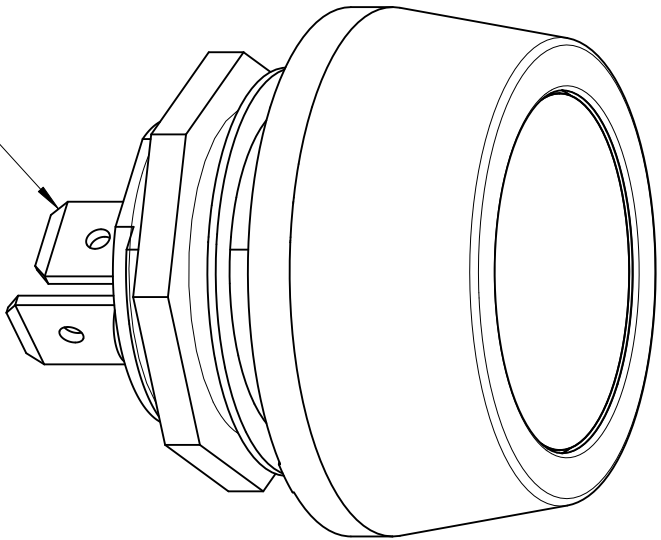

Bemerkungen / NOTES:

Kundenspezifische Verpackung beachten - siehe: ERP-System
PLEASE NOTE CUSTOMER-SPECIFIC PACKAGING - SEE:

Schaltbild
CIRCUIT DIAGRAM



Allgemeintoleranz/GENERAL TOLERANCE -			-	-	-	-	
			-	-	-	-	
			-	-	-	-	
Oberflaeche/SURFACE -			-	-	-	-	
			-	-	-	-	
			Index	Dat./DAT	Name	Aenderung/CHANGE DESCRIPTION	
Werkstoff/MATERIAL -			Gez. DWN	Datum/DATE 14 Jan 2026	Name RM	Benennung/TITLE ZB-Druckknopfschalter PUSH-BUTTON ASSY.	
			Gepr. CHECK	Datum/DATE siehe/SEE	Name PLM	Zeichnungsnr./DW G-NO	Format
	Massstab/SCALE 2:1	Blatt/SHEET 1 (1)		AK-Nr./AK-NO 270011001	Status -	270011001	A3
	Apparatebau Kirchheim-Teck GmbH						